


VUE EN PLAN - NIV. -1

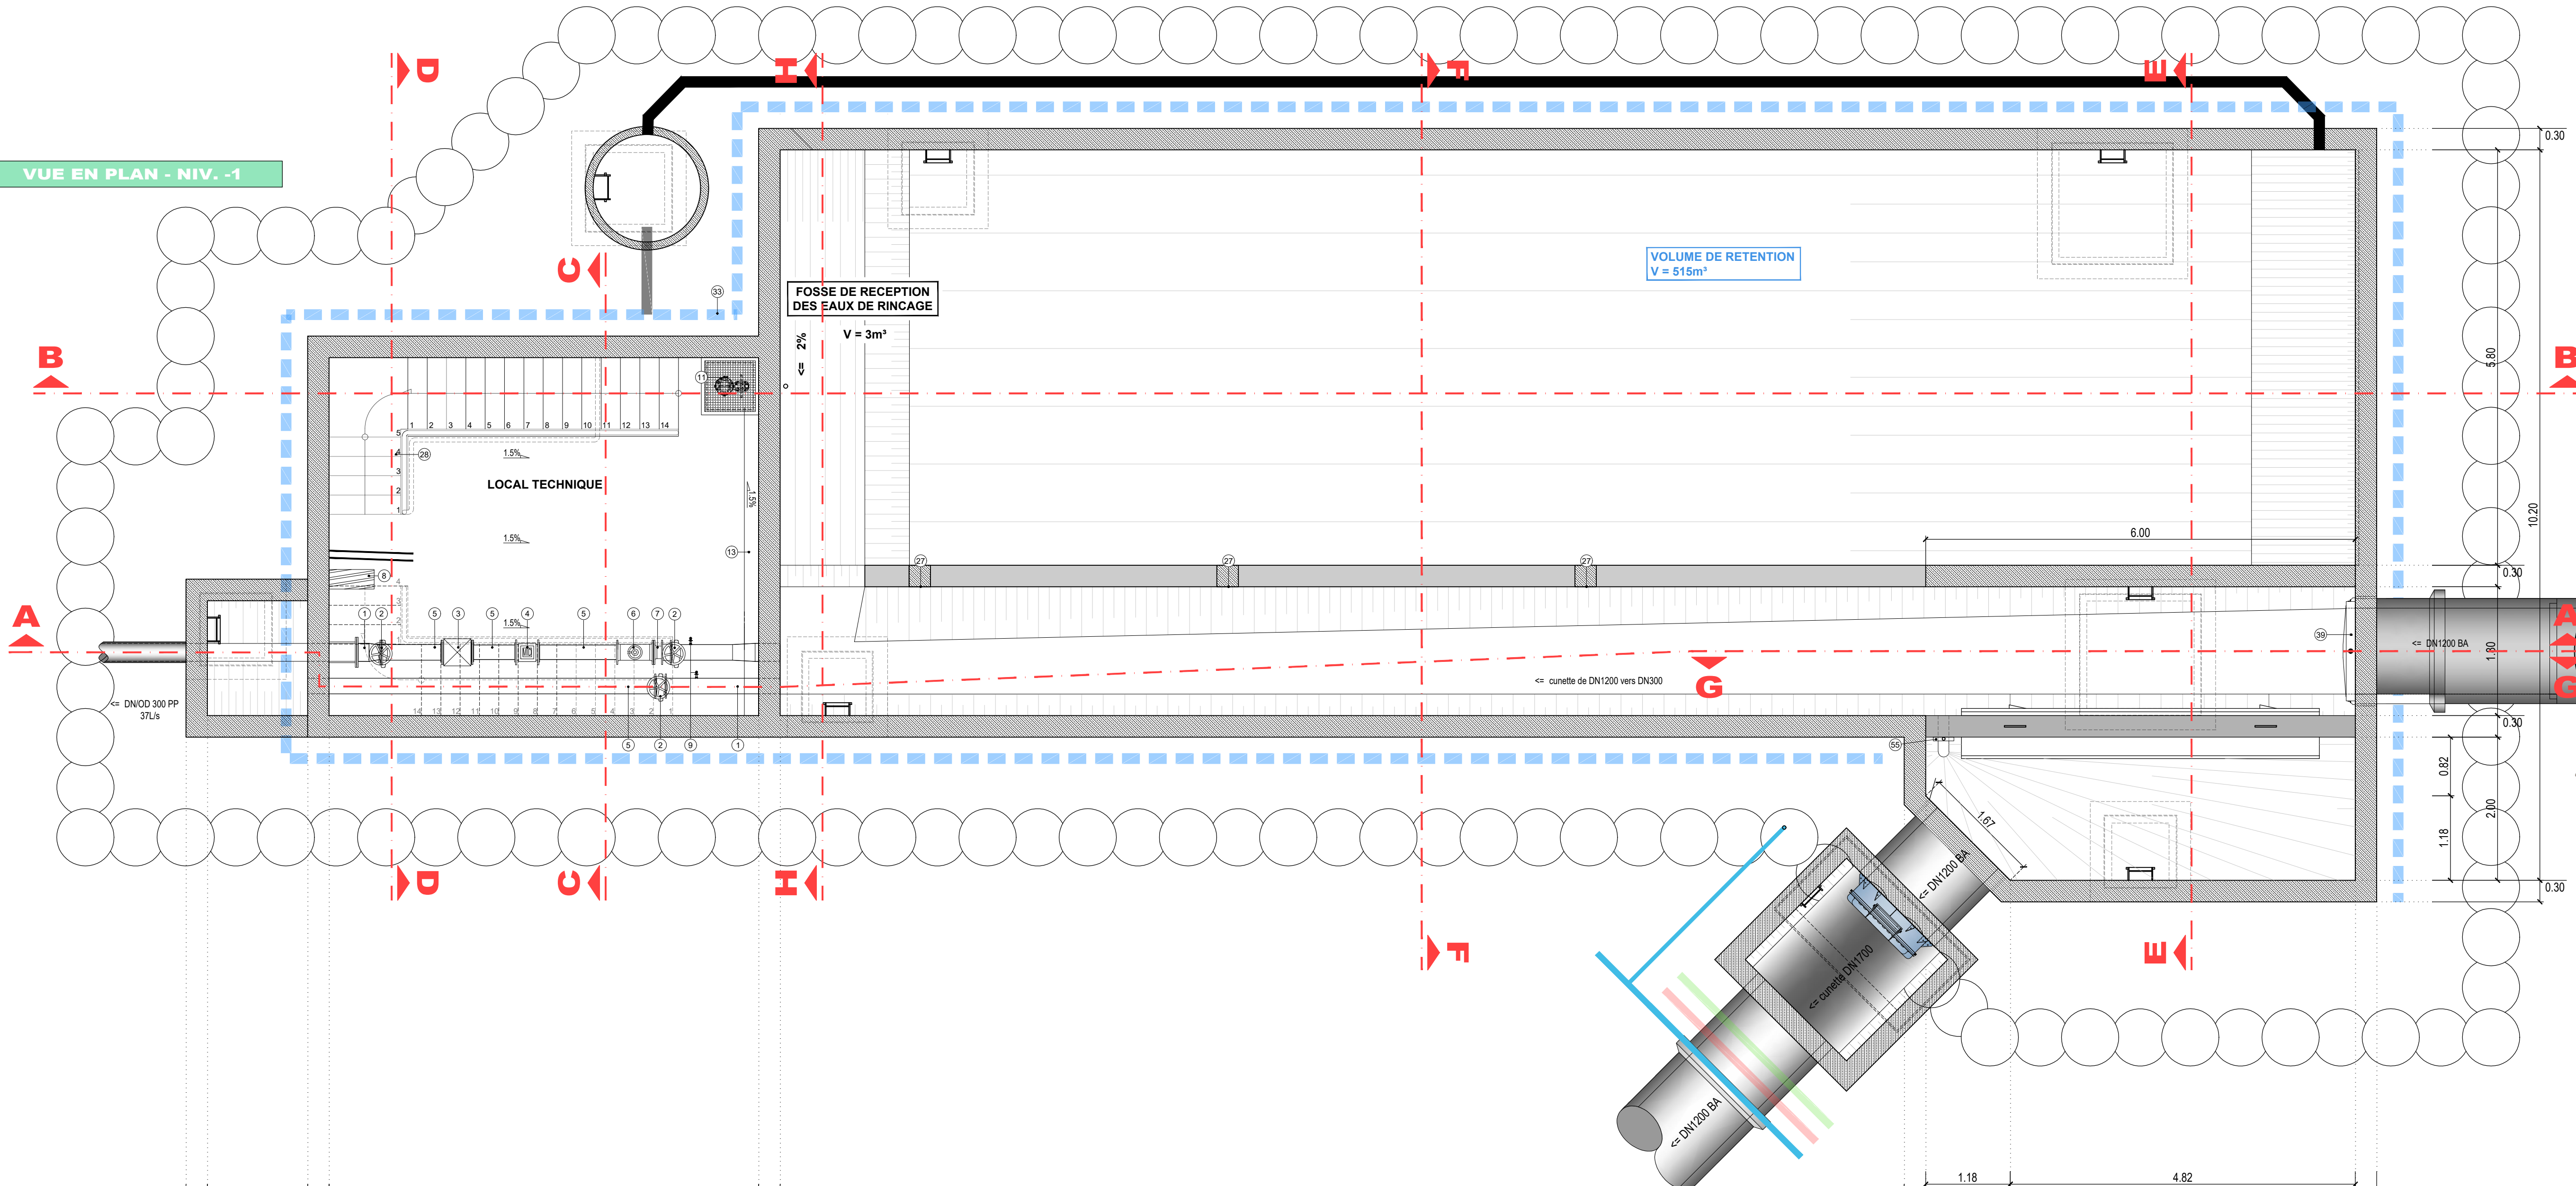

FOSSE DE RECEPTION
DES EAUX DE RINCAGE

$V = 3m^3$

VOLUME DE RETENTION
 $V = 515m^3$

LOCAL TECHNIQUE

cunette de DN1200 vers DN300

DNOD 300 PP
37L/s

DN1200 BA

cunette DN1700

1.18

4.82

0.30

5.80

10.20

0.30

1.90

0.30

0.82

2.00

0.30

1.18

4.82